

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

**ETA-07/0313**  
**of 27 February 2018**

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Trade name of the construction product

Product family  
to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment  
contains

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

Deutsches Institut für Bautechnik

Injection System WIT-PE 500

Injection system for post-installed  
rebar connections

Adolf Würth GmbH & Co. KG  
Reinhold-Würth-Straße 12-17  
74653 Künzelsau  
DEUTSCHLAND

Werk 3

19 pages including 3 annexes which form an integral part  
of this assessment

EAD 330087-00-0601

**European Technical Assessment**

**ETA-07/0313**

English translation prepared by DIBt

**Page 2 of 19 | 27 February 2018**

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The subject of this European Technical Assessment is the post-installed connection, by anchoring or overlap connection joint, of reinforcing bars (rebars) in existing structures made of normal weight concrete, using the "Injection system WIT-PE 500" in accordance with the regulations for reinforced concrete construction.

Reinforcing bars made of steel with a diameter  $\phi$  from 8 to 28 mm or the tension anchor ZA from sizes M12 to M24 according to Annex A and injection mortar WIT-PE 500 are used for rebar connections. The rebar is placed into a drilled hole filled with injection mortar and is anchored via the bond between rebar, injection mortar and concrete.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the rebar connections of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Amplification factor $\alpha_{lb}$ , Bond resistance $f_{bd}$	See Annex C 1

#### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Rebar connections satisfy requirements for Class A1
Resistance to fire	See Annex C 2 – C 3

### 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD No. 330087-00-0601, the applicable European legal act is: [96/582/EC].

The system(s) to be applied is (are): 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.


Issued in Berlin on 27 February 2018 by Deutsches Institut für Bautechnik

Dr.-Ing. Lars Eckfeldt  
p.p. Head of Department


*beglaubigt:*  
Baderschneider

## Cartridge: Injection mortar WIT-PE 500


385ml, 444ml, 585ml, 999ml and 1400ml injection mortar cartridge (Type: "side-by-side")

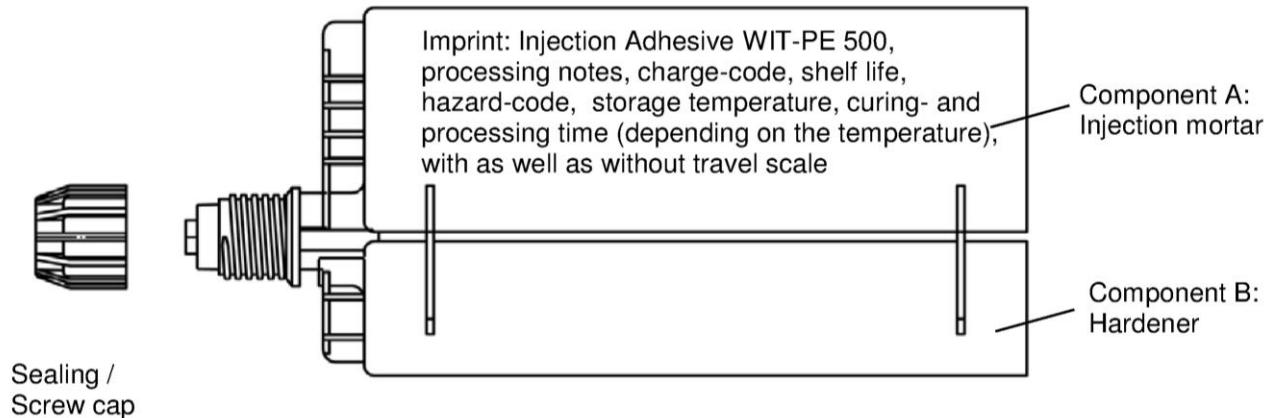


## Static Mixer

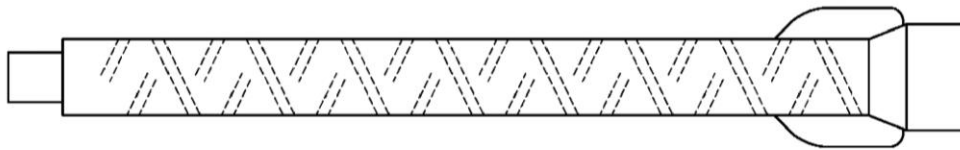

## Mixer extension WIT-MV and piston plug WIT-VS

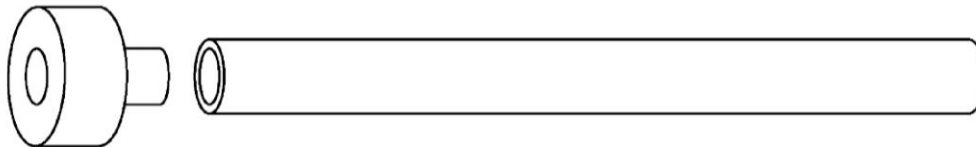

## Tension anchor ZA: M12, M16, M20, M24



## Reinforcing bar: Ø8, Ø10, Ø12, Ø14, Ø16, Ø20, Ø24, Ø25, Ø26, Ø28




## Injection System WIT-PE 500

### Product description


Injection System with tension anchor or reinforcing bar

Annex A1


### Application examples (reinforcing bar)

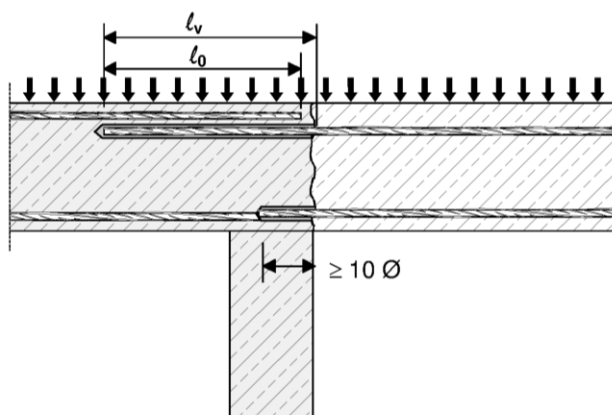


**Figure A1:** Overlap joint in slabs and beams

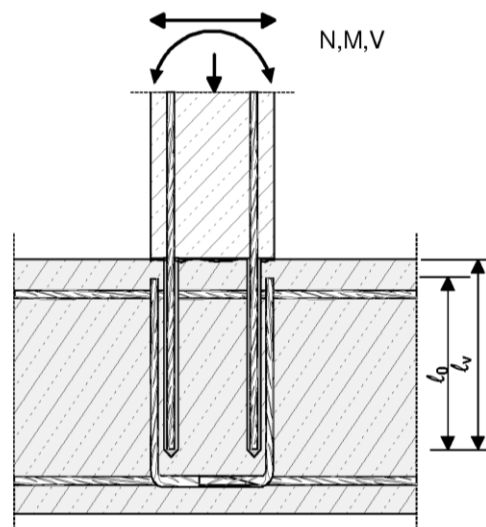


**Figure A2:** Overlap joint in a foundation of a column or wall where the rebars are stressed in tension

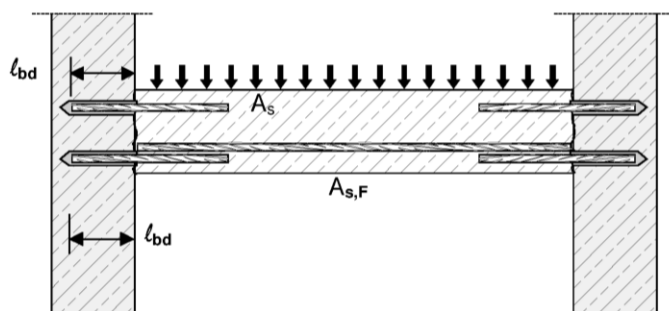

**Figure A3:** End anchoring of slabs or beams, designed as simply supported

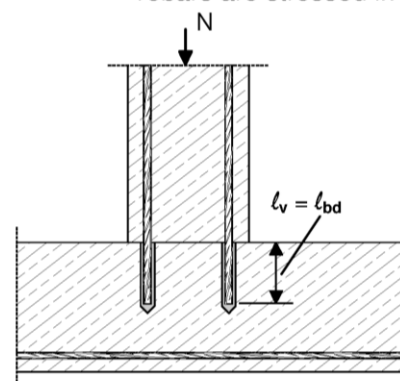

**Figure A4:** Rebar connection of components stressed primarily in compression. The rebars are stressed in compression.

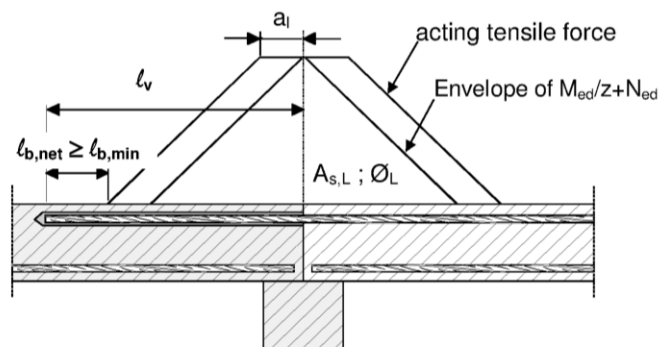

**Figure A5:** Anchoring of reinforcement to cover the line of acting tensile force

#### Note to Figure A1 – A5:

No transverse reinforcement acc. to EN 1992-1-1 is pictured.

The shear transfer between old and new concrete shall be designed according to EN 1992-1-1.

Notations and definitions of anchorages and overlap joints see Annex B2

### Injection System WIT-PE 500


#### Product description

Applications examples of post-installed rebars


### Annex A2




## Application examples (tension anchor ZA)

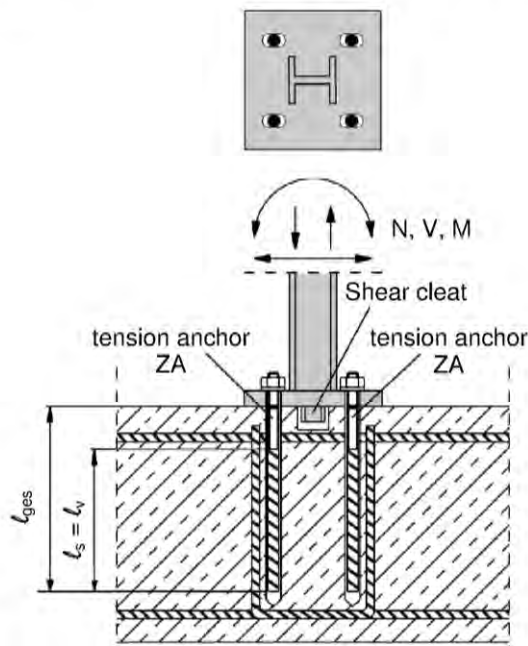

**Figure A6:** Overlap joint at the foundation of columns

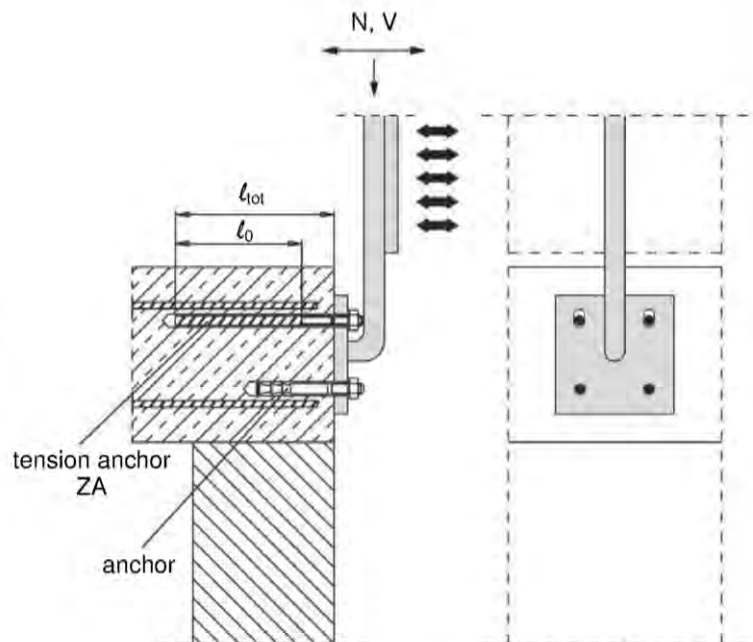

**Figure A7:** Overlap joint for the anchorage of guardrail posts

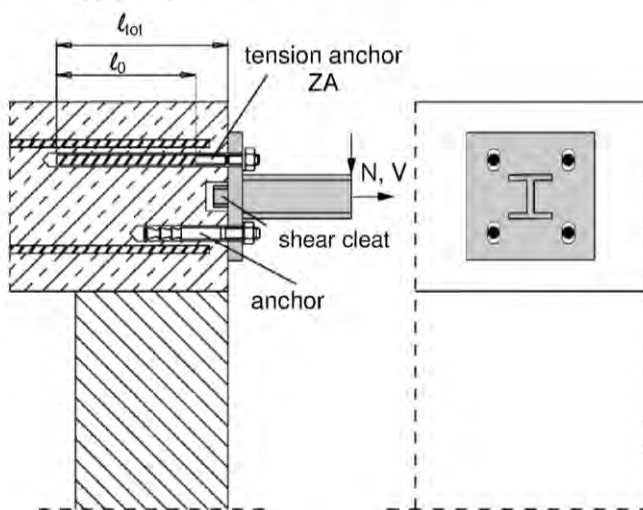

**Figure A8:** Overlap joint for the anchorage of cantilevers

### Note to Figure A6 to A8:

No transverse reinforcement according to EN 1992-1-1 is pictured. Notations and definitions of anchorage and overlap joints see Annex B2.

### The tension anchor ZA can only transfer forces towards the bar axis.

Tension forces must be transferred by an overlap joint into the present reinforcement of the member. The transmission of shear forces must be ensured by additional measures, e.g. by shear cleats or anchors with an European Technical Assessment (ETA). In the anchor plate the holes for the tension anchors must be designed as slotted holes towards the shear force.

Injection System WIT-PE 500

### Product description


Applications examples of tension anchor ZA

Annex A3

**Table A1: Material**

Part	Description	Material											
Tension anchor ZA		ZA vz				ZA A4				ZA HCR			
		M12	M16	M20	M24	M12	M16	M20	M24	M12	M16	M20	M24
1	Rebar	Class B according to NDP or NCL of EN 1992-1-1 $f_{uk} = f_{tk} = k \cdot f_{yk}$											
2	Threaded rod	Steel, zinc plated acc. to EN 10087:1998 or EN 10263:2001				Stainless steel, 1.4362, 1.4401, 1.4404, 1.4571, EN 10088:2014				High corrosion resistant steel, 1.4529, 1.4565, EN 10088:2014			
	$f_{yk}$ [N/mm <sup>2</sup> ]	640				640		560		640		560	
3	Washer	Steel, zinc plated				Stainless steel				High corrosion resistant steel			
4	Hexagon nut	Steel, zinc plated acc. to EN 10087:1998 or EN 10263:2001				Stainless steel, 1.4362, 1.4401, 1.4404, 1.4571, EN 10088:2014				High corrosion resistant steel, 1.4529, 1.4565, EN 10088:2014			
Rebar													
5	Rebar EN 1992-1-:2004+ AC:2010, Annex C	Bars and de-coiled rods class B or C $f_{yk}$ and $k$ according to NDP or NCL of EN 1992-1-1 $f_{uk} = f_{tk} = k \cdot f_{yk}$											

**Figure A9: Tension anchor ZA, marking**

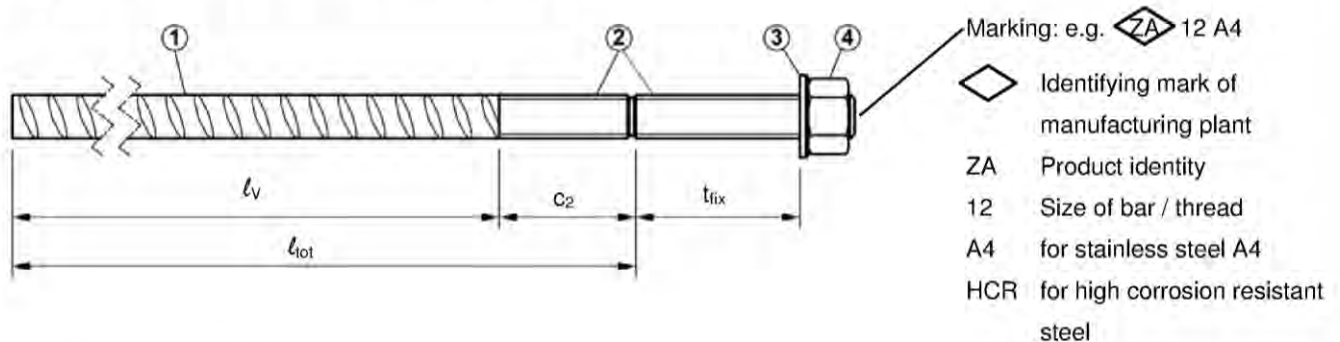

**Figure A10: Rebar**



**Injection System WIT-PE 500**

**Product description**  
Materials, Marking

**Annex A4**



## Specifications of intended use

### Anchorage subject to:

- Static or quasi static action
- Fire exposure

### Base material:

- Reinforced or unreinforced normal weight concrete acc. to EN 206-1:2000.
- Strength classes C12/15 to C50/60 acc. to EN 206-1:2000.
- Maximum chloride concrete of 0,40 % (CL 0,40) related to the cement content acc. to EN 206-1:2000.
- Non-carbonated concrete.

Note: In case of a carbonated surface of the existing concrete structure the carbonated layer shall be removed in the area of the post-installed rebar connection with a diameter of  $\varnothing + 60$  mm prior to the installation of the new rebar.

The depth of concrete to be removed shall correspond to at least the minimum concrete cover in accordance with EN 1992-1-1:2004+AC:2010.

The foregoing may be neglected if building components are new and not carbonated and if building components are in dry conditions.

### Temperature range:

- - 40 °C to +80 °C (max. long term temperature +80 °C and max. short term temperature +50 °C)

### Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (zinc plated steel, stainless steel or high corrosion resistant steel).
- Structures subject to external atmospheric exposure including industrial and marine environment or exposure to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel or high corrosion resistant steel).
- Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions (high corrosion resistant steel).

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

### Design:

- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Anchorages are designed in accordance with EN 1992-1-1 and Annex B2.
- The actual position of the reinforcement in the existing structure shall be determined on the basis of the construction documentation and taken into account when designing.

### Installation:

- Dry or wet concrete
- The rebar connection must not be placed in water-filled boreholes.
- Overhead installation admissible
- Check the position of the existing rebars (if the position of existing rebars is not known, it shall be determined using a rebar detector suitable for this purpose as well as on the basis of the construction documentation and then marked on the building component for the overlap joint)
- Hole drilling by hammer drill, vacuum drill, compressed air drill or diamond drill mode.
- While curing of the injection mortar, the temperature of the member shall not fall below +5°C and must not exceed +40°C.
- The installation of post-installed rebar or tension anchor ZA shall be done only by suitable trained installer and under supervision on site; the conditions under which an installer may be considered as suitable trained and the conditions for supervision on site are up to the member states in which the installation is done.

Injection System WIT-PE 500


Intended use  
Specifications of intended use

Annex B1

## General construction rules for post-installed reinforcing bars and tension anchor ZA


- Bond strength  $f_{bd}$  acc. to EN 1992-1-1 may be applied.
- The shear transfer between old and new concrete shall be designed acc. to EN 1992-1-1.
- If the clear distance of overlapping bars is greater than  $4 \varnothing$ , the lap length must be increased by a length equal to the clear space where it exceeds  $4 \varnothing$ .
- The minimum concrete cover acc. to EN 1992-1-1 shall be kept.

**Figure B1: Post-installed rebars**

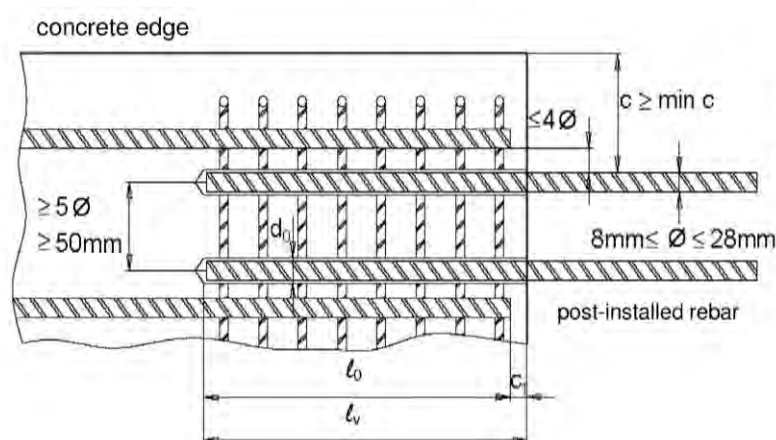

- $c$  concrete cover of post-installed reinforcement
- $c_1$  concrete cover at front end of cast-in-place rebar
- $\min c$  minimum concrete cover according Table B1
- $\varnothing$  diameter of post-installed rebar
- $l_0$  lap length acc. to EN 1992-1-1
- $l_v$  embedment depth  $\lambda_v \geq \lambda_0 + c_1$
- $d_0$  nominal drill bit diameter according to Annex B4, Table B4

**Figure B2: Tension anchor ZA**

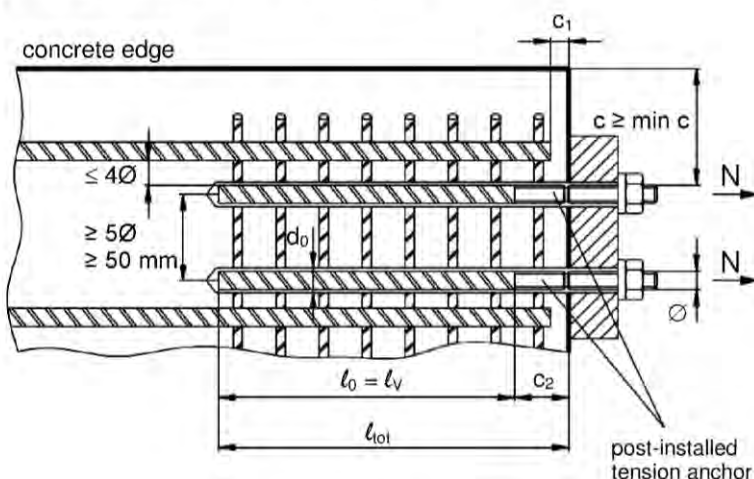

- $c$  concrete cover of post-installed tension anchor ZA
- $c_1$  concrete cover at front side of cast-in-place rebar
- $\min c$  minimum concrete cover acc. to Table B1
- $c_2$  length of bonded thread ( $c_2 > c_1$ ; see Table B1)
- $\varnothing$  diameter of tension anchor
- $l_0$  lap length acc. to EN 1992-1-1
- $l_{tot}$  embedment depth  $l_{tot} \geq l_0 + c_2$
- $d_0$  nominal drill bit diameter according Annex B4, Table B4

Injection System WIT-PE 500

Intended use  
General construction rules


Annex B2

**Table B1: Minimum concrete cover  $\min c^{1)}$  of post-installed rebars and tension anchor**

Drilling method	Rebar diameter	$\min c$ (without drilling aid device)	$\min c$ (with drilling aid device)
Hammer drilling, vacuum drilling, diamond core drilling	< 25 mm	30 mm + 0.06 $\ell_v \geq 2 \varnothing$	30 mm + 0.02 $\ell_v \geq 2 \varnothing$
	$\geq 25$ mm	40 mm + 0.06 $\ell_v \geq 2 \varnothing$	40 mm + 0.02 $\ell_v \geq 2 \varnothing$
Compressed air drilling	< 25 mm	50 mm + 0.08 $\ell_v$	50 mm + 0.02 $\ell_v$
	$\geq 25$ mm	60 mm + 0.08 $\ell_v$	60 mm + 0.02 $\ell_v$

**ZA depending on drilling method and drilling tolerances**

<sup>1)</sup> Minimum concrete cover acc. to EN 1992-1-1 must be observed.

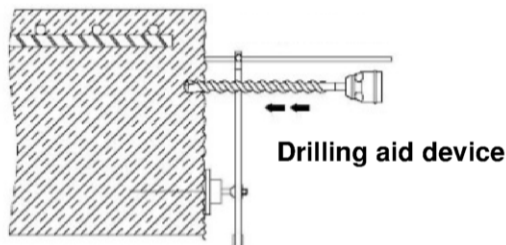

**Table B2: Dimensions and installation parameters of tension anchor ZA**

Anchor size			M12	M16	M20	M24
Rebar diameter	$\varnothing$	[mm]	12	16	20	25
Cross-section area (threaded part)	$A_s$	[mm <sup>2</sup> ]	84	157	245	353
Width across nut flats	SW	[mm]	19	24	30	36
Effective embedment depth	$\ell_v$	[mm]	$\ell_v = \ell_{tot} - c_2$			
Length of bonded thread	steel, zinc plated	$c_2$	[mm]	$\geq 20$	$\geq 20$	$\geq 20$
	A4 / HCR			$\geq 100$	$\geq 100$	$\geq 100$
Maximum installation torque	$T_{inst}$	[Nm]	50	100	150	150

**Table B3: Maximum embedment depth**

Rebar / Tension Anchor ZA	Mortar temperature	Max. embedment depth $\ell_{v, max}$
$\varnothing$ 8 to 12 mm	+5°C to +19°C	130 cm
	$\geq 20^\circ\text{C}$	200 cm
$\varnothing$ 14 to 28 mm	+5°C to +19°C	200 cm
	$\geq 20^\circ\text{C}$	280 cm

**Injection System WIT-PE 500**

**Intended use**


Minimum concrete cover, installation parameters, maximum embedment depth

**Annex B3**



**Table B4: Cleaning and installation tools**

Rebar Ø	Tension anchor ZA	Drill bit diameter d <sub>0</sub>	Blow out nozzle Ø	Brush Ø (diamond drilling)	Mixer extension (outer Ø)	Piston plug WIT-VS
[mm]	[-]	[mm]	[mm]	[mm]	[mm]	[-]
8	-	12	10	13.0	10	-
10	-	14	10	15.5		14
12	M12	16	14	17.5		16
14	-	18	14	19.5		18
16	M16	20	17	22	16	20
20	M20	25	17	27		25
24	-	30	27	32		28
25	M24	32	27	34		32
26	-	32	27	34		32
28	-	35	27	37		35

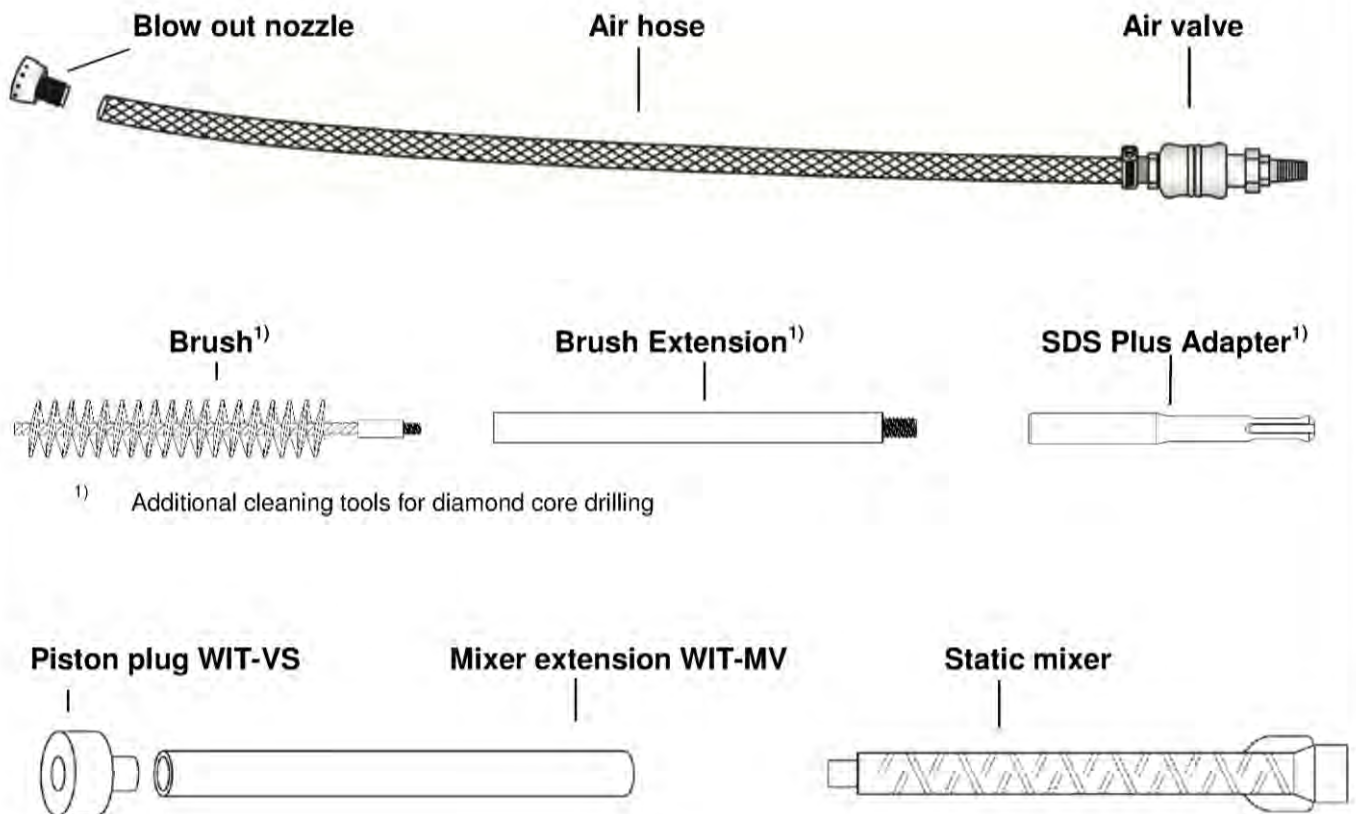

**Injection System WIT-PE 500**

**Intended use**  
Cleaning and Installation tools

**Annex B4**

**Table B5: Working time and curing time**

Temperature in the bore hole	Working time	Minimum curing time
+5°C to +9°C	60 min	72 h
+10°C to +19°C	45 min	36 h
+20°C to +29°C	30 min	10 h
+30°C to +39°C	20 min	6 h
+40°C	12 min	4 h

Note: A mortar temperature  $> +20^{\circ}\text{C}$  reduces the press out forces and accelerates the injection of the mortar. When using the adhesive in wet concrete the curing times have to be doubled.


## Installation instructions

### Preperation:

- Remove carbonated concrete and roughen concrete surface prior to installation of post-installed rebars.
- Determine position and diameter of existing reinforcement. Only the admissible force of the existing reinforcement can be transmitted into the post-installed rebar connection
- The drilling aid device must be adjusted towards the existing reinforcement
- The concreting joints must be roughened to at least such an extent that the aggregates protrude

## Making and cleaning of hammer drilled, vacuum drilled and compressed air drilled holes

### Bore hole drilling

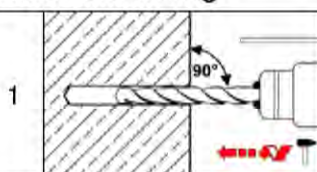

Select drill bit diameter according to Table B4. Build drill hole by hammer drilling, vacuum drilling or compressed air drilling. In case of aborted holes, the bore holes must be filled with mortar.

### Cleaning



Assemble provided blow out nozzles, air hoses and air valve and connect to compressed air ( $\geq 6$  bar). Place marking on the air hose at a distance from the end equal to the drill hole depth. Open compressed air valve and blow out **4x** from top to bottom and reverse. The air hose marking has to get below the concrete surface in order to ensure cleaning to the very bottom of the hole.

## Injection System WIT-PE 500

### Intended use

Working and curing time, Installation instructions – Preperation;  
Making and cleaning of hammer drilled, vacuum drilled and compressed air drilled holes



## Annex B5









## Installation instruction (continuation)

### Marking and cleaning of diamond core drilled holes

#### Bore hole drilling

1a		Drill hole by using a diamond drill with diamond drill bit.
1b		Remove drill core at least up to the nominal hole depth and check drill hole depth.

#### Cleaning

2a		Flush drill hole with water, starting from the bottom, until clear water gets out of the drill hole.
2b		Choose brush suitable to the hole. Brush bore hole 2x using a cordless screwdriver or a drilling machine. Use brush extension for deep holes.
2c		Flush drill hole again with water, starting from the bottom, until clear water gets out of the drill hole.
2d		Assemble provided blow out nozzles, air hoses and air valve and connect to compressed air ( $\geq 6$ bar). Place marking on the air hose at a distance from the end equal to the drill hole depth. Open compressed air valve and blow out 2x from top to bottom and reverse. The air hose marking has to get below the concrete surface in order to ensure cleaning to the very bottom of the hole.
2e		Brush the hole again 2x (according to step 2b).
2f		Blow out again 2x (according to step 2d).

### Injection System WIT-PE 500







#### Intended use

Installation instructions  
Making and cleaning of diamond core drilled holes

Annex B6

## Installation Instruction (continuation)

### Injection into bore hole

3a		Mark the position of the embedment depth $l_v$ on the rebar.
3b		Check bore hole depth by inserting rebar or tension anchor up to the marking in the empty hole.
4		Prepare cartridge with static mixer, mixer extension and piston plug. Mixer extension must correspond the hole depth.
5		<p>Attach marking length <math>l_m</math> on mixer extension for injection of adhesive:</p> <p>a) Estimation: <math>l_m = 1/3 * h_1</math> [mm]</p> <p>b) Precise formula for optimum volume (compressed air drilling): <math>l_m = h_1 * (1.2 * \frac{\phi^2}{d_0^2} - 0.2)</math> [mm]</p> <p><math>l_m</math> Length from the end of the piston plug to the mark on the mixer extension  <math>h_1</math> drill hole depth = embedment depth (<math>l_v</math> resp. <math>l_{tot}</math>)  <math>\phi</math> rebar diameter  <math>d_0</math> nominal drill bit diameter</p> <p>When using hammer drill or diamond core, the length <math>l_m</math> may be multiplied by 1,10.</p>
6		Prior to applying, discard at least a 10 cm line of mortar (forerun) until the mortar shows a consistent colour. Never use this mortar!
7		Fill the hole starting from the bottom with injection mortar WIT-PE 500 without air bubbles. Inject until the marking $l_m$ on the extension pipe can be seen.

### Injection System WIT-PE 500





#### Intended use

Installation instructions  
Injection into bore hole

Annex B7

## Installation Instruction (continuation)

### Installation of rebar or tension anchor

7		<p>Push the rebar or tension anchor into the hole while turning slightly until the embedment depth is reached.</p> <p>The bar should be free of dirt, grease, oil or other foreign material.</p>
8		<p>Excessive adhesive must exceed out of the drill hole. Otherwise pull out rebar, drill out hole after curing of the adhesive and start again from No. 2.</p>
9		<p>Keep curing time according to Annex B5, Table B5.</p> <p>Do not move or load the rod during curing time.</p>
10		<p>After curing, the rod can be loaded.</p>

### Injection System WIT-PE 500

#### Intended use

Installation instructions  
Installation of rebar or tension anchor

**Annex B8**



### Minimum anchorage length and minimum lap length

The minimum anchorage length  $\ell_{b,min}$  and the minimum lap length  $\ell_{0,min}$  according to EN 1992-1-1 ( $\ell_{b,min}$  acc. to Eq. 8.6 and Eq. 8.7 and  $\ell_{0,min}$  acc. to Eq. 8.11) shall be multiplied by the amplification factor  $\alpha_{lb}$  acc. to Table C1.

**Table C1: Amplification factor  $\alpha_{lb}$**

Concrete strength class	Drilling method	Amplification factor $\alpha_{lb}$
C12/15 to C50/60	Hammer drilling, vacuum drilling or compressed air drilling	1,0
	Diamond coring	1,5

**Table C2: Design values of the ultimate bond resistance  $f_{bd}$ <sup>1)</sup>**

Rebar Tension Anchor ZA		Concrete strength class								
		C12/15	C16/20	C20/25	C25/30	C30/37	C35/45	C40/50	C45/55	C50/60
<b>Design value of bond resistance <math>f_{bd}</math></b>										
Hammer drilling, vacuum drilling or compressed air drilling	[N/mm <sup>2</sup> ]	1.6	2.0	2.3	2.7	3.0	3.4	3.7	4.0	4.3
Diamond coring	[N/mm <sup>2</sup> ]	1.6	2.0	2.3	2.7	3.0	3.0	3.4	3.7	3.7

<sup>1)</sup> With  $\eta_1 = 1,0$  acc. to EN 1992-1-1 for good bond conditions (for all other bond conditions multiply the values by 0,7)

**Injection System WIT-PE 500**

**Performances**  
Amplification factor  
Design values of ultimate bond resistance  $f_{bd}$

**Annex C1**

**Design value of ultimate bond stress  $f_{bd,fi}$  under fire exposure for concrete classes C12/15 to C50/60 (all drilling methods):**

The design value of ultimate bond stress  $f_{bd,fi}$  under fire exposure will be calculated by the following equation:

$$f_{bd,fi} = k_{b,fi}(\theta) \cdot f_{bd} \cdot \gamma_c / \gamma_{M,fi}$$

with:  $\theta \leq 270^\circ\text{C}$   $k_{b,fi}(\theta) = 9221.2 \cdot \theta^{-1.747} / (f_{bd} \cdot 4.3) \leq 1.0$

$\theta > 270^\circ\text{C}$   $k_{b,fi}(\theta) = 0$

$f_{bd,fi}$  design value of ultimate bond stress in case of fire in N/mm<sup>2</sup>

$\theta$  Temperature in °C in the mortar layer

$k_{b,fi}(\theta)$  Reduction factor under fire exposure


$f_{bd}$  Design value of the ultimate bond stress in N/mm<sup>2</sup> in cold condition according to Table C2 considering concrete class, rebar diameter, drilling method and the bond conditions according to EN 1992-1-1.

$\gamma_c$  partial factor acc. to EN 1992-1-1

$\gamma_{M,fi}$  partial factor acc. to EN 1992-1-2

For evidence under fire exposure the anchorage length shall be calculated according to EN 1992-1-1:2004+AC:2010 Equation 8.3 using the temperature-dependent ultimate bond stress  $f_{bd,fi}$ .

**Picture C1: Example graph of reduction factor  $k_{b,fi}(\theta)$**   
Concrete strength class C20/25 for good bond conditions

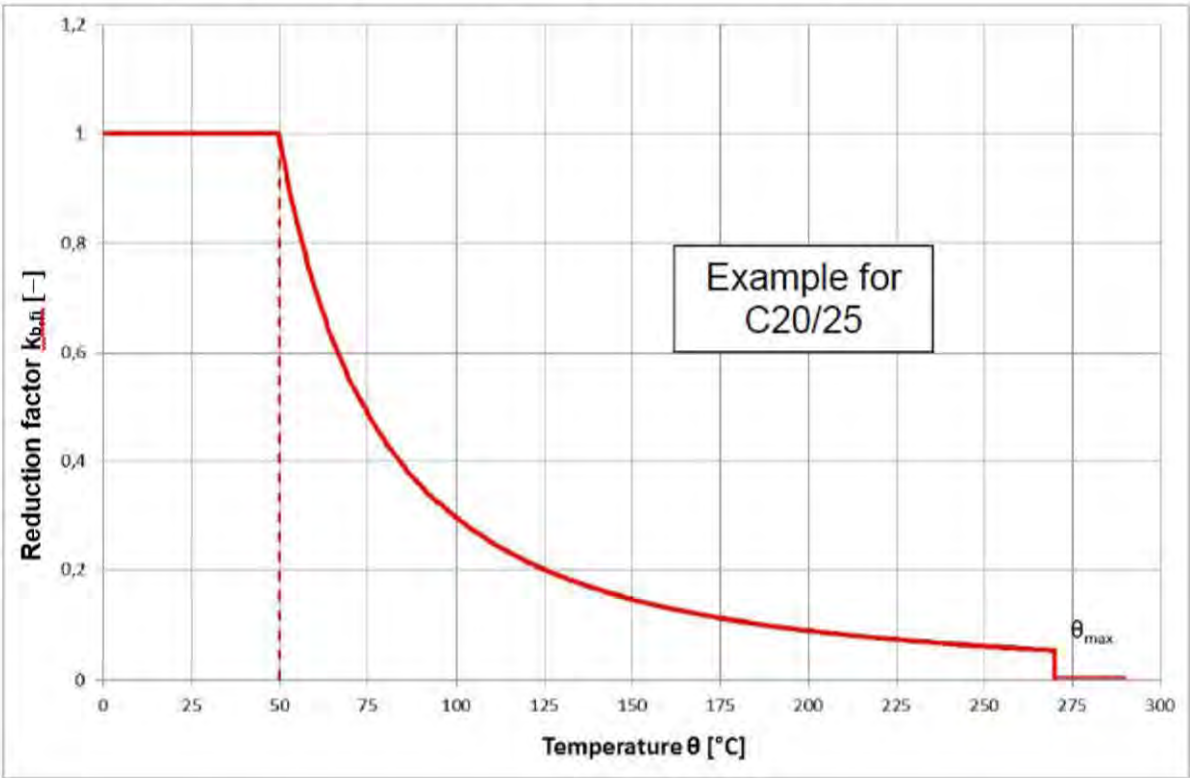

Injection System WIT-PE 500

**Performances**

Design value of ultimate bond stress  $f_{bd,fi}$  under fire exposure

**Annex C2**



**Table C3: Characteristic tension strength in case of fire for tension anchor ZA,**  
concrete strength class C12/15 to C50/60, acc. to Technical Report TR 020

Tension anchor ZA		M12	M16	M20	M24
Steel, zinc plated					
Characteristic tension strength	R30	$\sigma_{Rk,s,fi}$ [N/mm²]	20		
	R60		15		
	R90		13		
	R120		10		
Stainless steel A4, HCR					
Characteristic tension strength	R30	$\sigma_{Rk,s,fi}$ [N/mm²]	30		
	R60		25		
	R90		20		
	R120		16		

**Design value of the tension strength  $\sigma_{Rd,s,fi}$  under fire exposure for tension anchor ZA**

The design value of the steel strength  $\sigma_{Rd,s,fi}$  under fire exposure will be calculated by the following equation:

$$\sigma_{Rd,s,fi} = \sigma_{Rk,s,fi} / \gamma_{M,fi}$$

with:

$\sigma_{Rk,s,fi}$  characteristic steel strength acc. to Table C3  
 $\gamma_{M,fi}$  partial factor under fire exposure acc. to EN 1992-1-2

**Injection System WIT-PE 500**

**Performances**

Steel strength for tension anchor ZA under fire exposure

**Annex C3**